

0	12.02.02	ISSUED	AC	AC	
Rev.	Date	Description	Drawn	Checked	Approved
<b>CACCIALANZA &amp; C.</b> S.p.A. ANTINCENDIO SICUREZZA ANTINQUINAMENTO SEGRATE (MILANO) - ITALY		Client / Project			
		Title			
	Date	Name	FIELD COMMAND PANEL UZK LKS6 EEXD EXECUTION		
Drawn	12.02.02	CA			
Checked	12.02.02	CA			
Approved	12.02.02	AM			
Code	Sys.	Size	Scale	Dwg nr.	Rev.
		A3		46414701	0
				Sheet	1
				of	3
THIS DRAWING IS THE PROPERTY OF CACCIALANZA & C. S.p.A. AND IS NOT TO BE REPRODUCED OR USED TO FURNISH ANY INFORMATION FOR MAKING OF DRAWINGS OR APPARATUS EXCEPT WHERE PROVIDED FOR BY AGREEMENT WITH SAID COMPANY					

SHEET	DESCRIPTION										SHEET	DESCRIPTION										0
	MODIFY											MODIFY										
	A	B	C	D	E	F	G	H	I			A	B	C	D	E	F	G	H	I		
1	COVER										29											
2	MODIFY TABLE										30											
3	TECHNICAL DATA										31											1
4	UZK LAY-OUT AND FRONT PANEL										32											
											33											
											34											2
											35											
											36											
											37											3
											38											
											39											
											40											4
											41											
											42											
											43											5
											44											
											45											
											46											6
											47											
											48											
											49											7
											50											
											51											
											52											8
											53											
											54											
											55											9
											56											

<b>CACCIALANZA &amp; C</b> S.p.A. ANTINCENDIO SICUREZZA ANTINQUINAMENTO SEGRATE (MILANO) - ITALY	<b>TITLE</b> FIELD COMMAND PANEL TYPE A3-A4-A6-A8/EL	<b>CLIENT</b>	DATE 12.02.02	DWG N° 46414701
			SCALE	
			DRAWN CA	
			CHECKED CA	PROJECT N°
0 ISSUED	12.02.02	DATE	APPROVED	SHEET N° 2 OF 4

a b c d e f g h i j k l m n o p q r

0  
1  
2  
3  
4  
5  
6  
7  
8  
9

### PANEL BOARD TECHNICAL DATA

RATED SERVICE VOLTAGE:.....400V	TYPE OF SEGREGATION:.....FORM 1	TEMPERATURE:.....40°C
RATED INSULATION VOLTAGE:.....1000V	INSTALLATION:.....OUTDOOR	DEGREE OF PROTECTION:see page 10-11
RATED FREQUENCY:.....50Hz	COMPLIANCE WITH STANDARD:.....CEI 17/13.1	COLOR:.....RED RAL7032
ELECTRICAL SYSTEM:.....3Ph+PE	IN/OUT CABLES:.....BOTTOM	

**CACCIALANZA & C** S.p.A.  
 ANTINCENDIO SICUREZZA ANTINQUINAMENTO  
 SEGRATE (MILANO) - ITALY


TITLE  
 FIELD COMMAND PANEL  
 TYPE A3-A4-A6-A8/EL

CLIENT

		DATE	12.02.02	DWG N°	46414701
		SCALE			
		DRAWN	CA		
0	ISSUED	12.02.02	CHECKED	CA	PROJECT N°
REV.	MODIFY	DATE	APPROVED		SHEET N°. 3 OF 4

a b c d e f g h i j k m n p q r

0  
1  
2  
3  
4  
5  
6  
7  
8  
9

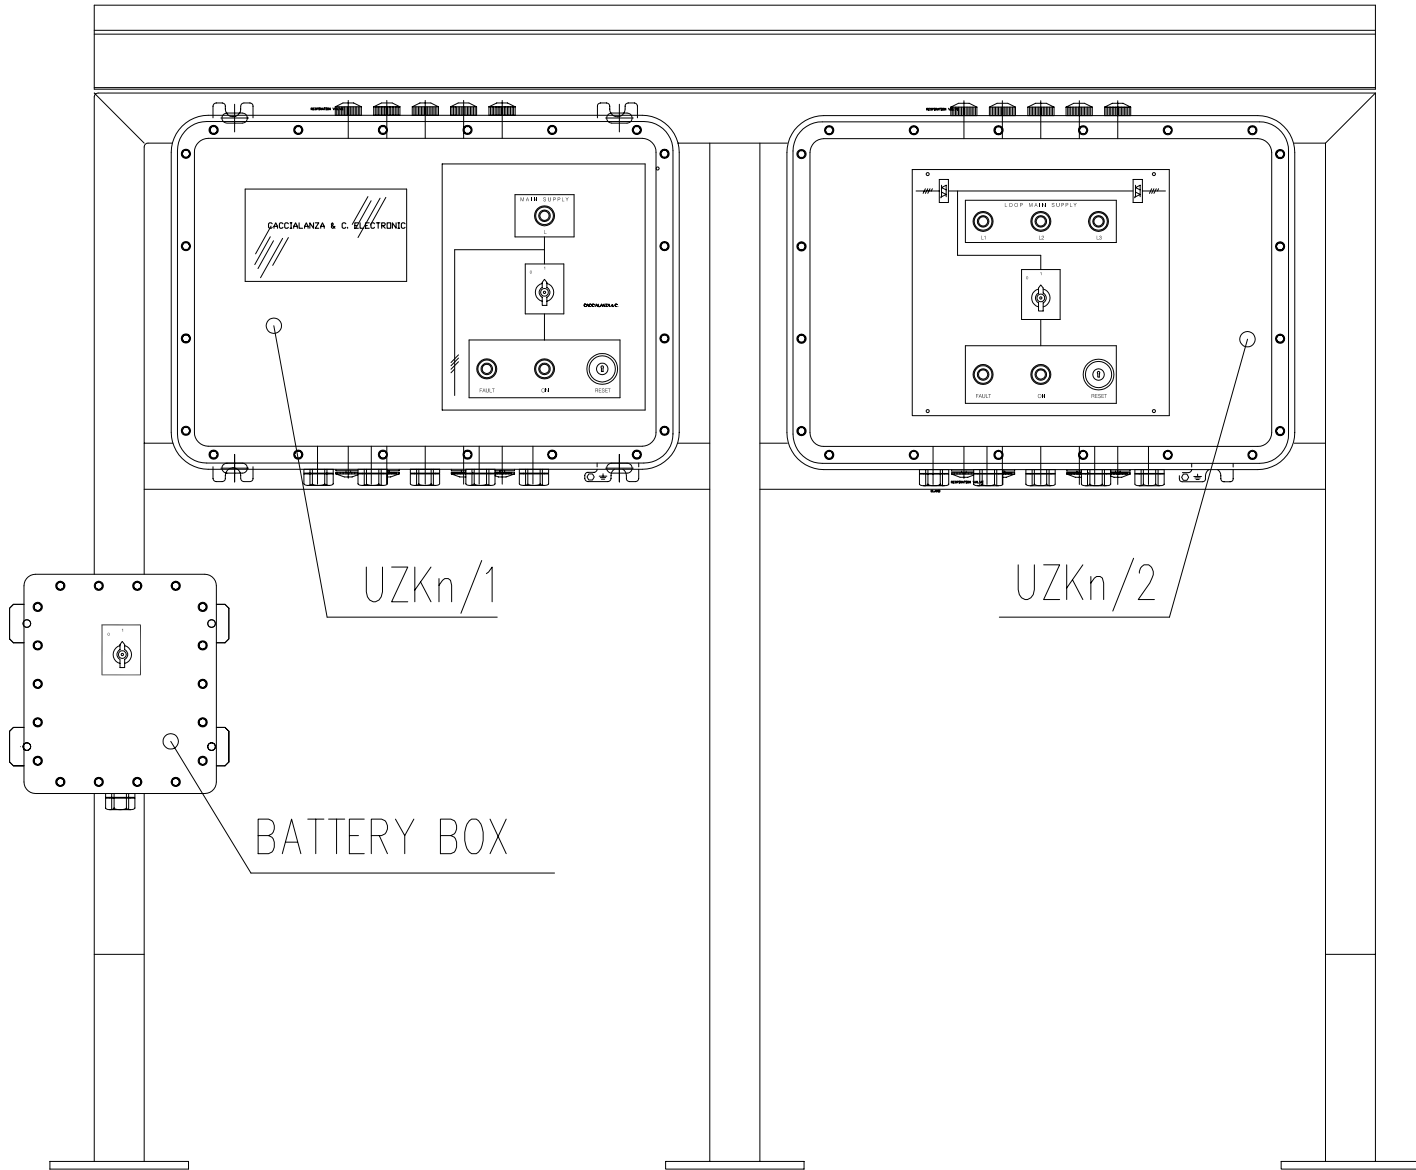

TO GET THE ELECTRICAL DAIGRAM OF THIS PANEL  
PLEASE CONTACT OUR COMPANY

**CACCIALANZA & C.** S.p.A.  
ANTINCENDIO SICUREZZA ANTINQUINAMENTO  
SEGRATE (MILANO) - ITALY

TITLE  
FIELD COMMAND PANEL  
TYPE A3-A4-A6-A8/EL

CLIENT

		DATE	12.02.02
		SCALE	
		DRAWN	CA
0	ISSUED	12.02.02	CHECKED CA
REV.	MODIFY	DATE	APPROVED

DWG N° 46414701  
PROJECT N°  
SHEET N°. 4 OF 4